WAS VALVE NOTE

3" FLG. RES. WEDGE GATE VALVE w/ EXTENDED STEM & HANDWHEEL OPERATOR @ 6" ABOVE TOP OF HANDRAIL. PROVIDE STEM SUPPORT FROM EXIST. HANDRAIL AS REQUIRED.

AERATION AIR HEADER NOTE

CONTRACTOR TO WELD STEEL PLATE IN AIR HEADER TO PROVIDE SEPARATION BETWEEN OXIC ZONE 1 AND OXIC ZONE 2 AIR SUPPLY. ALL WELDED JOINTS SHALL BE AIR TIGHT UPON COMPLETION.

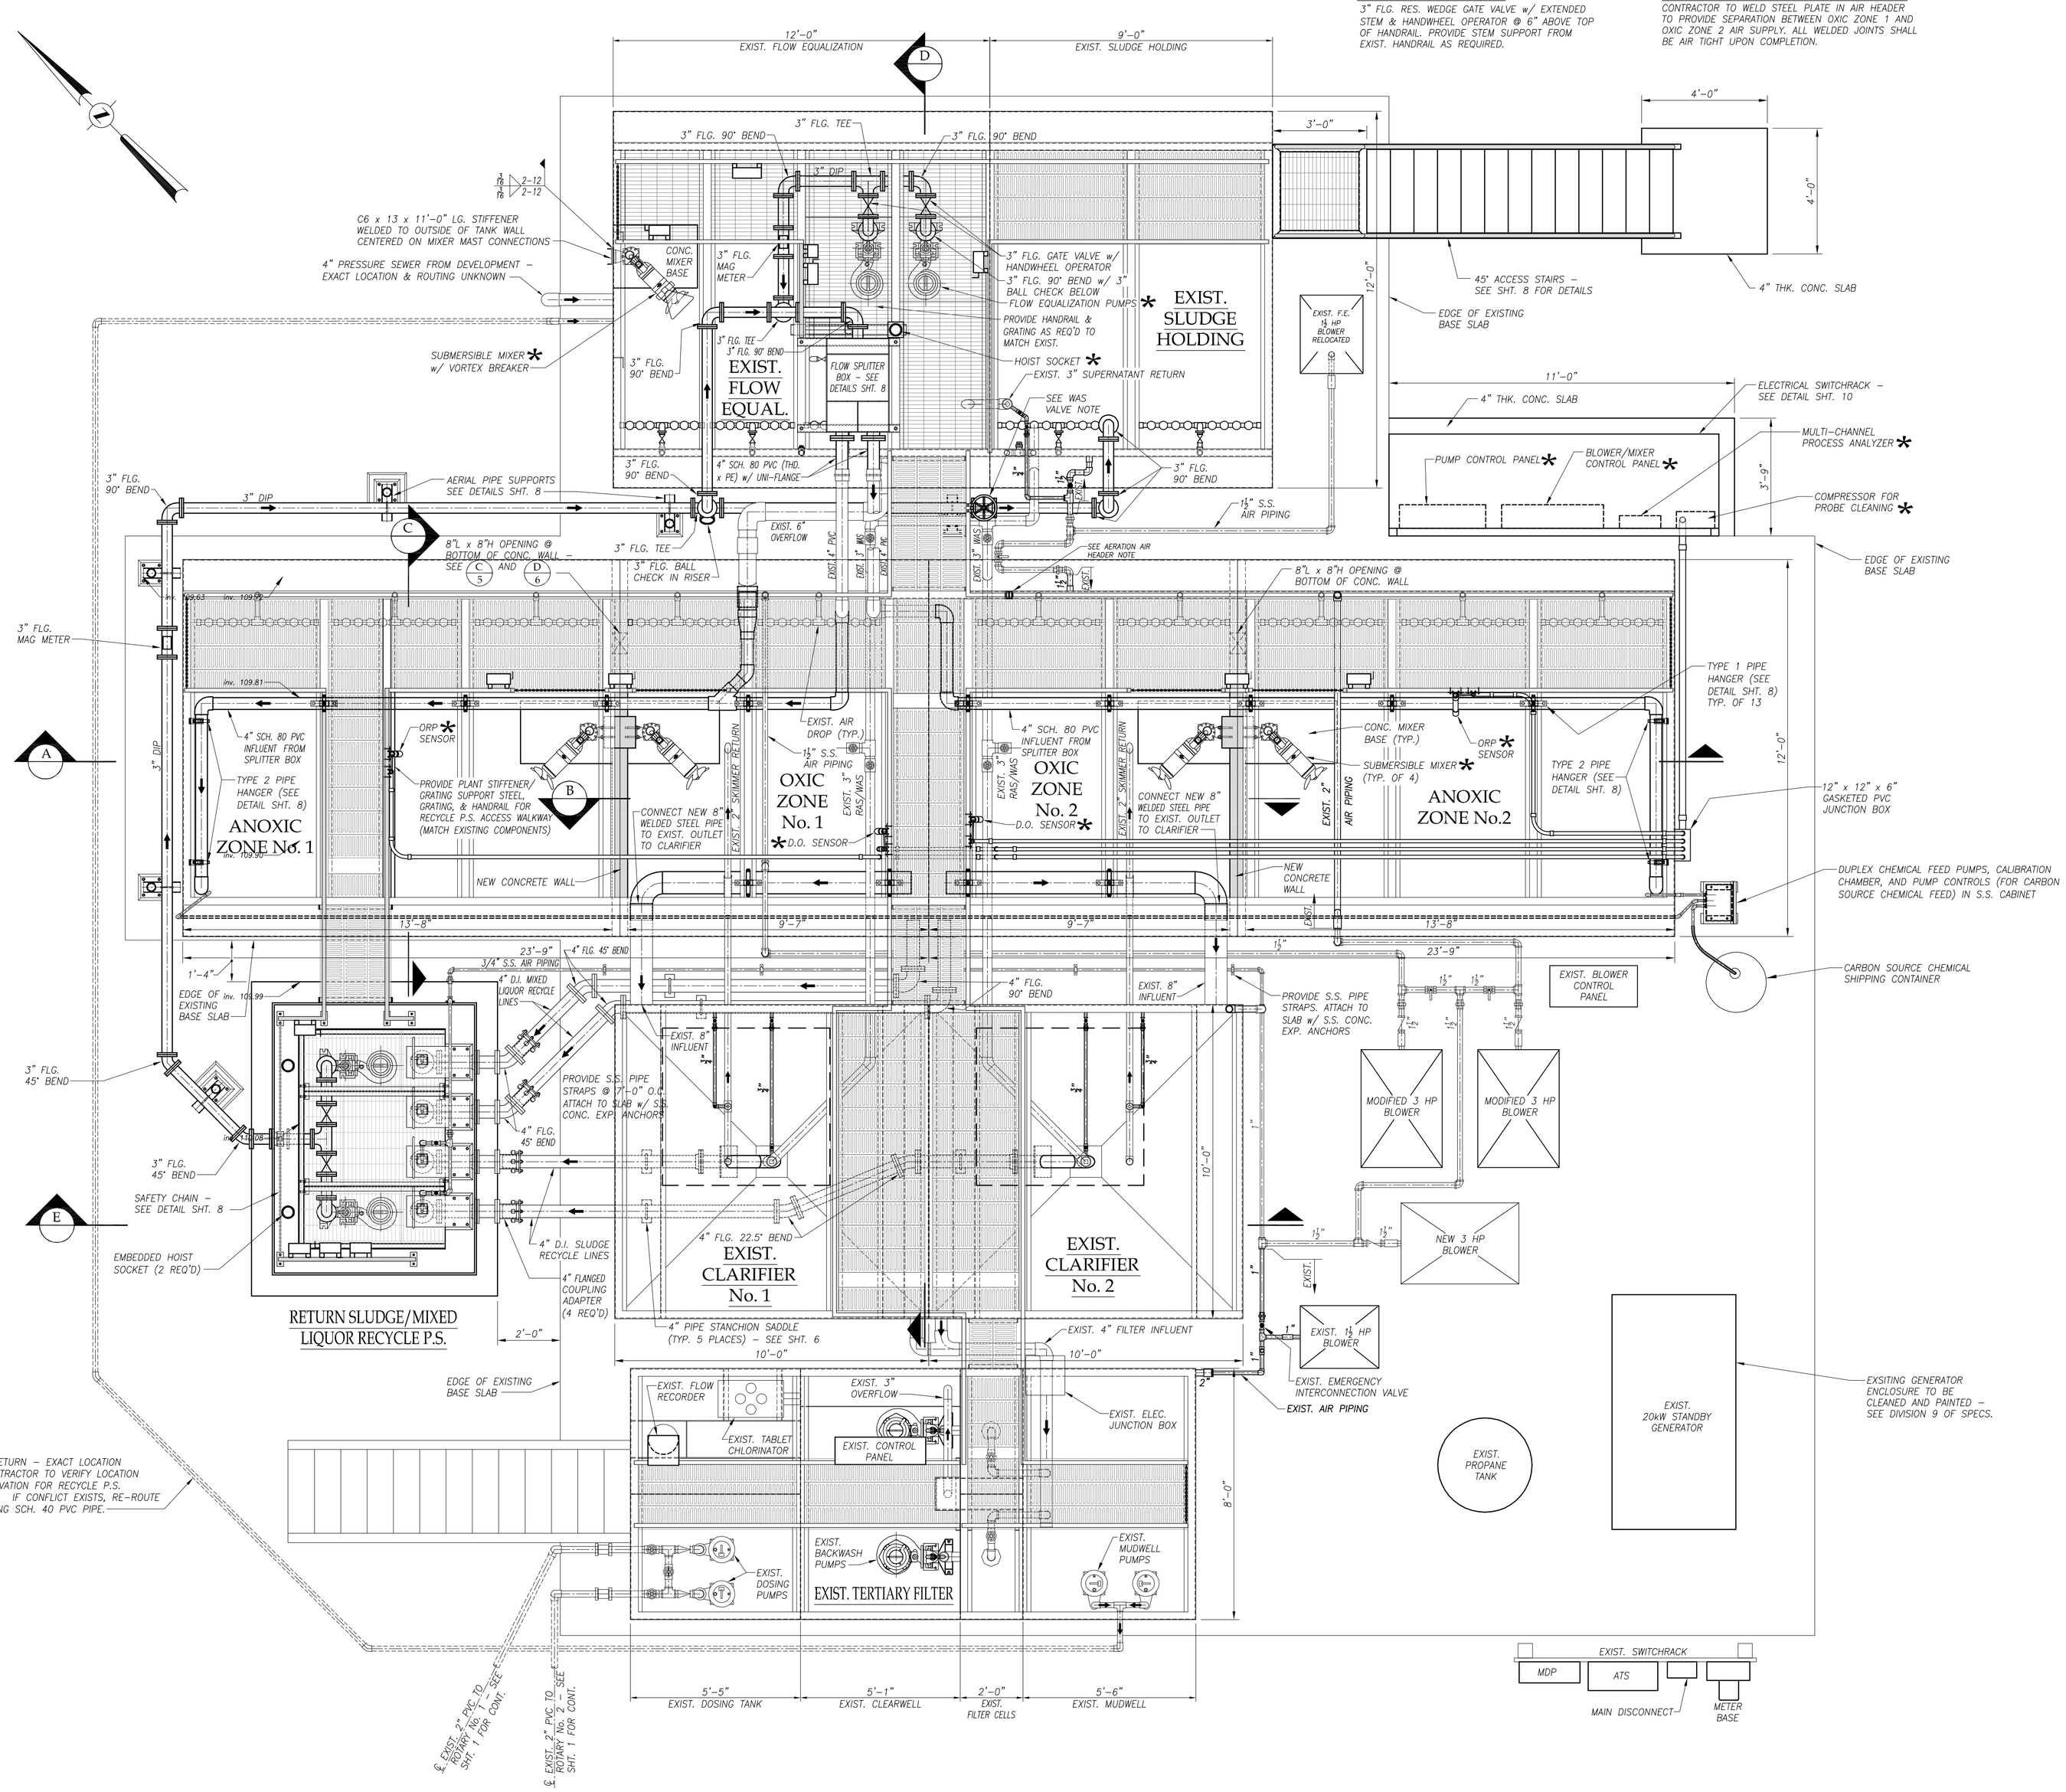

JOB NO. –
DESIGN JFP
DRAWN JLB
CHECKED JFP
SCALE 1/8" = 1'-0"
FILE SIP-PLANT

REVISIONS:

CONSULTING ENGINEERS
DIEHL & PHILLIPS, P.A.
219 E. CHATHAM ST.
CARY, N.C. 27511 • (919) 467-9972

D&P

MODIFICATIONS TO WWTP
FOR
SEA ISLE PLANTATION NORTH
CARTERET COUNTY, NORTH CAROLINA

ADDITIONS TO EXISTING TREATMENT PLANT
-